

THE PORT AUTHORITY
OF NY & NJ



ORIGINAL SIGNED & SEALED BY
N.Y. P.E. (OR R.A.)

**Joseph R. Loring
& Associates, Inc.**
consulting engineers

One Pennsylvania Plaza
New York, New York 10008-0045
Tel: (212) 363-7400, Fax: (212) 363-7382

THE OFFICE OF

DAVID

LEIBOWITZ

P.E.

LESLIE E. ROBERTSON
ASSOCIATES, R.L.P.
CONSULTING STRUCTURAL ENGINEERS
200 EAST 40TH STREET
NEW YORK, N.Y. 10018
TEL. (212) 697-0000 FAX (212) 697-0001

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT
COPY OF ONE OF THE CONTRACT DOCUMENTS
IN THE PROJECT IN WHICH SAID DRAWINGS EXISTED AT
THE TIME THE SAID CONTRACT WAS EXECUTED BY
THE PARTIES.
DATE 11/16/99 *William A. Arlano*
DATE 11/16/99 *P.K. Swanson*
SPEC. WITNESS
ENGINEER OF DESIGN

No.	Date	Revision	Approved
1	11/17/97	ISSUED FOR BID	
Engineering Department Design Divisions			

The
World
Trade
Center



STANDBY POWER
5 WORLD TRADE CENTER

ELECTRICAL


5 WTC PART PLANS
CONDUIT RISER SHAFTS
& DETAILS SHEET 2

This drawing subject to conditions in contract.
All inventions, ideas, designs and methods
herein are reserved to Port Authority and
may not be used without its written consent.


Designed by	M.A.R.	Drawn by	Check by
Date	11/17/97	Scale	AS NOTED
Contract Number	WTC-945.071	Drawing Number	E4-03

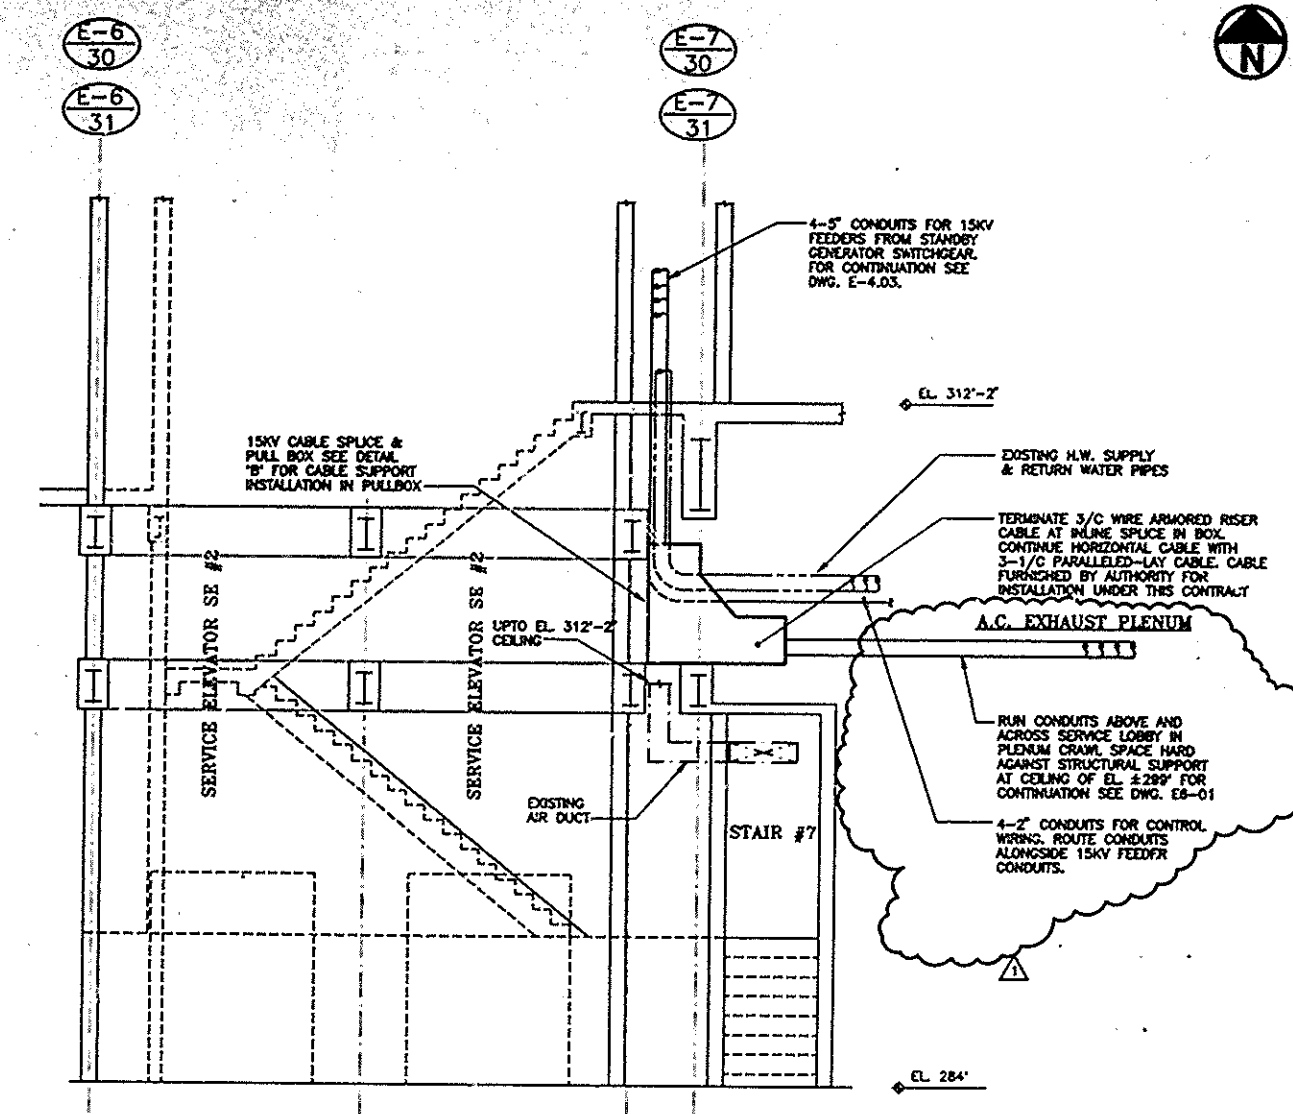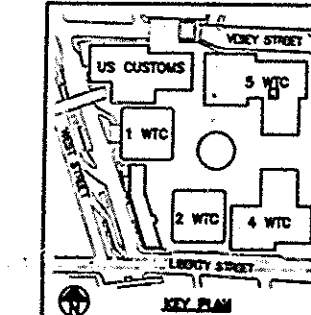

SECTION A

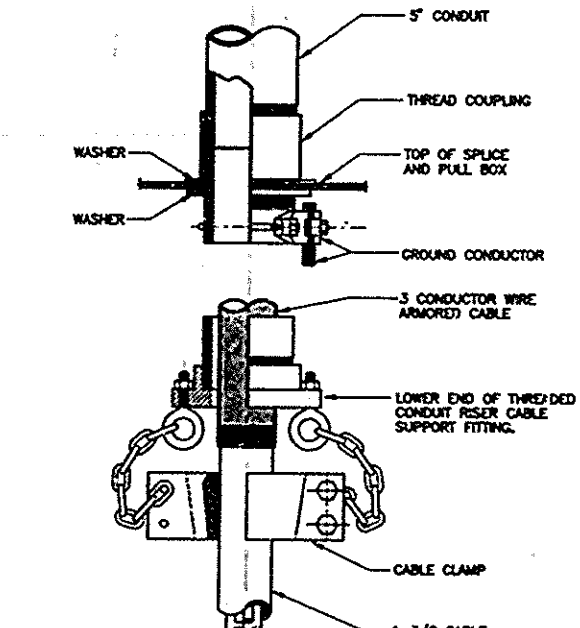

DETAIL 'B'
TYPICAL INSTALLATION OF
15KV ARMORED CABLE AUXILIARY
SUPPORT IN SPLICE AND PULLBOX
NOT TO SCALE

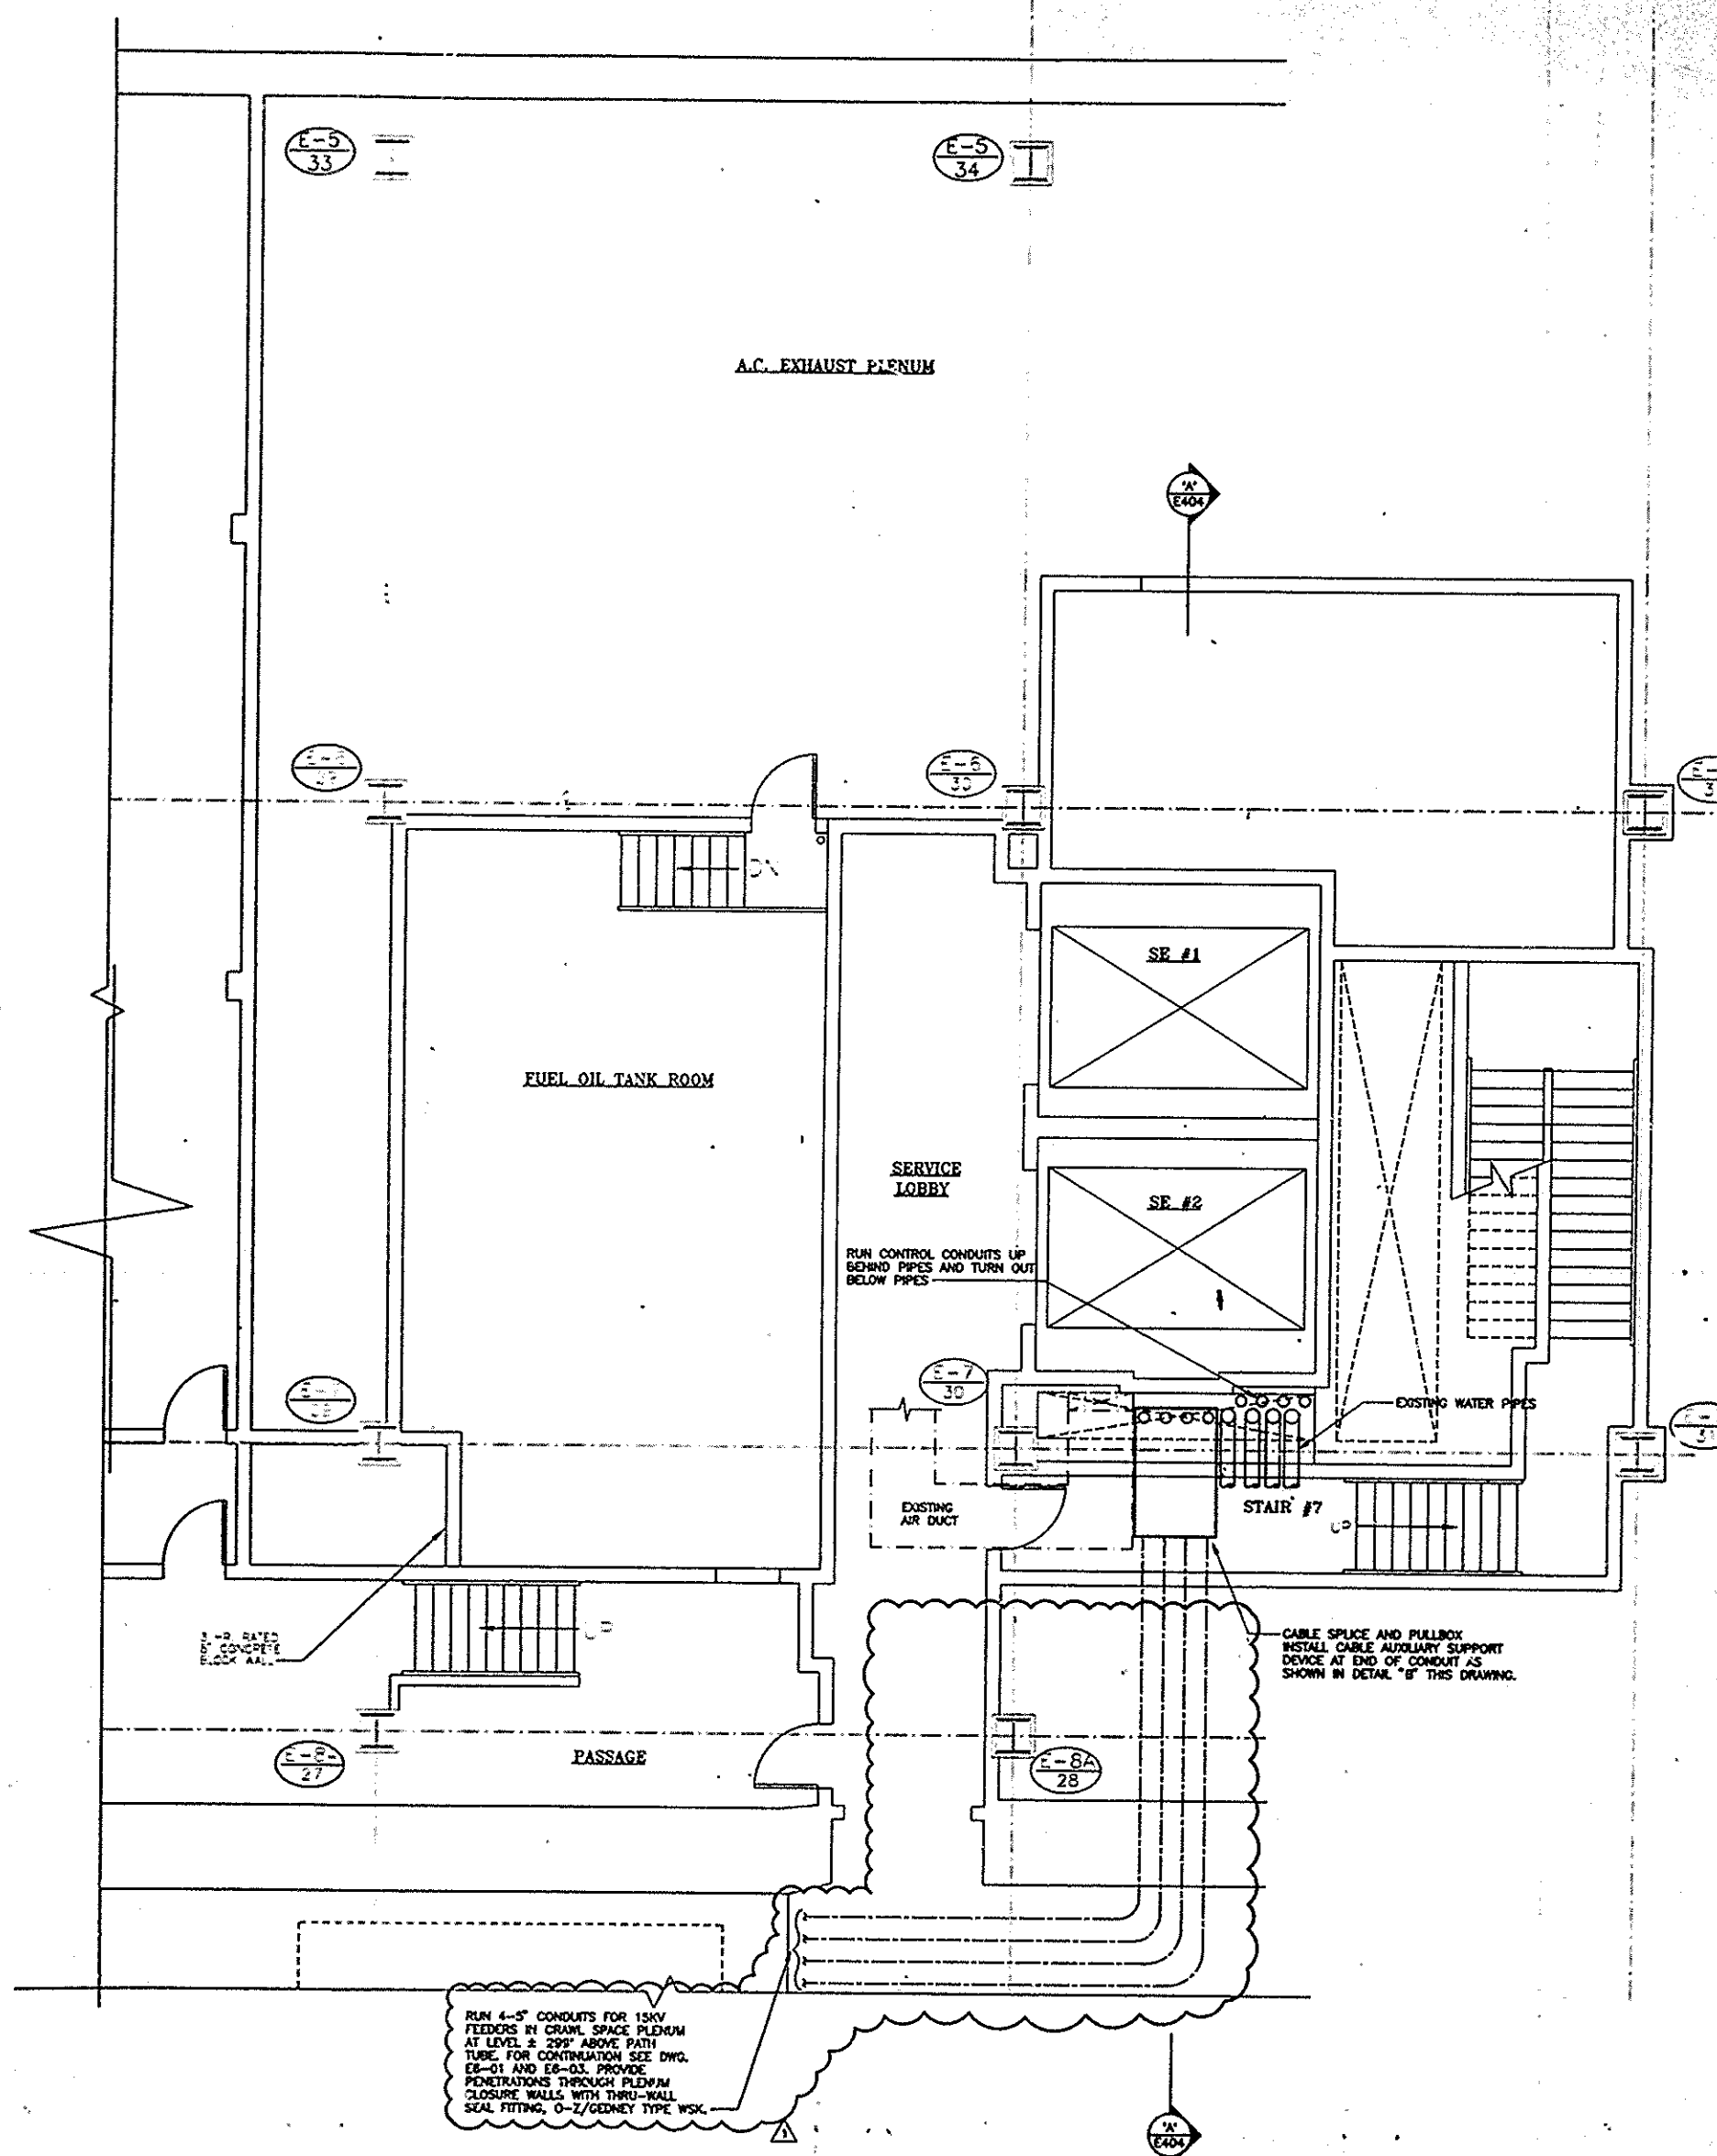

5 WTC B-2 LEVEL PART PLAN